Proficient Technologies

Customer:
ABC Hospital
111 Health Care Road
Anytown, USA

8/1/2013 10:41:50 AM

ST17BDSC02089…

8/1/2013 10:34:56 AM

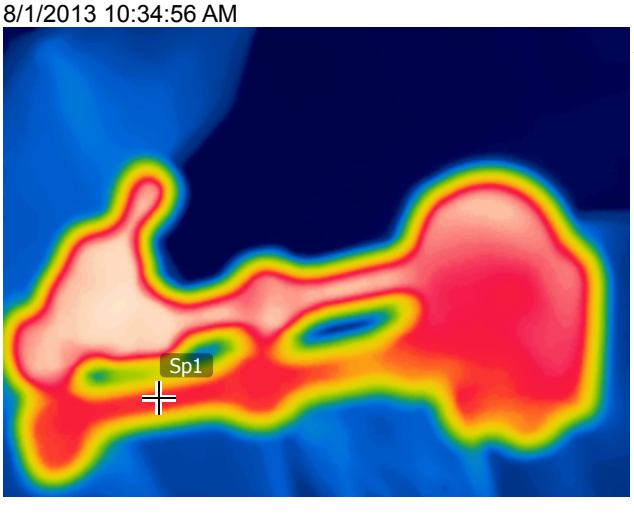

ST17bBIR_1424.jpg FLIR T300 48801115

Above (left & right): F&T type steam trap on 12 psig drip leg with atmospheric condensate return FAILED OPEN. Note: tested with ultrasonic and infrared inspection.

Measurements	°F
Sp1	208.1

Parameters	
Emissivity	0.95
Refl. temp.	68 °F

Below (left & right): Replacement F&T type steam trap on 12 psig drip leg with atmospheric condensate return OK. Note: confirmed with ultrasonic and infrared inspection.

9/19/2013 9:58:52 AM

ST17ADSC02389…

9/19/2013 9:51:06 AM

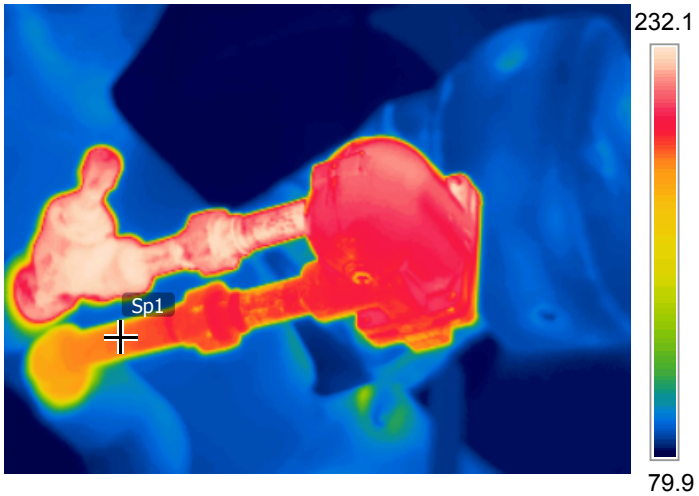

ST17AIR_1527.jpg FLIR T300 48801115

Measurements	°F
Sp1	198.4

Parameters	
Emissivity	0.95
Refl. temp.	68 °F