Customer:
ABC Hospital
111 Health Care Road
Anytown, USA

8/1/2013 9:56:09 AM

VJDB11DSC020…

8/1/2013 9:45:24 AM

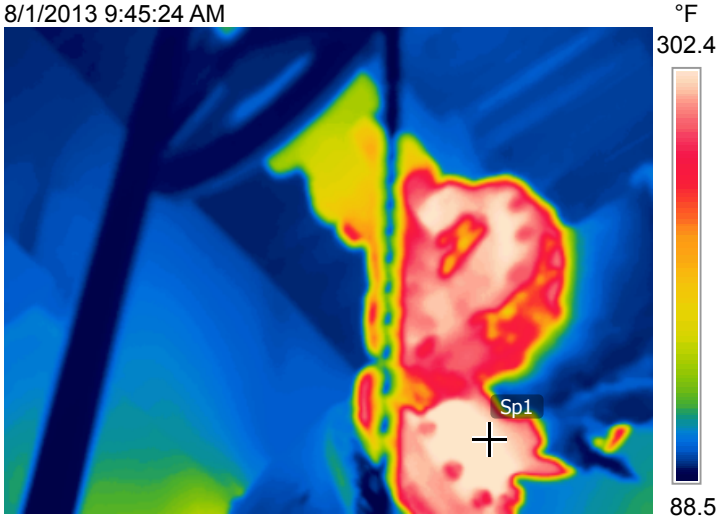

VJIRB11IR_1400.jpg FLIR T300 48801115

Above (left & right): Partially insulated 6" gate valve in 75 psig saturated steam service.

Measurements	°F
Sp1	302.4

Parameters	
Emissivity	0.95
Refl. temp.	68 °F

Below (left & right): Removable valve cover insulation installed on 6" gate valve in 75 psig saturated steam service.

9/19/2013 9:44:21 AM

VJDA11DSC023…

9/19/2013 9:35:20 AM

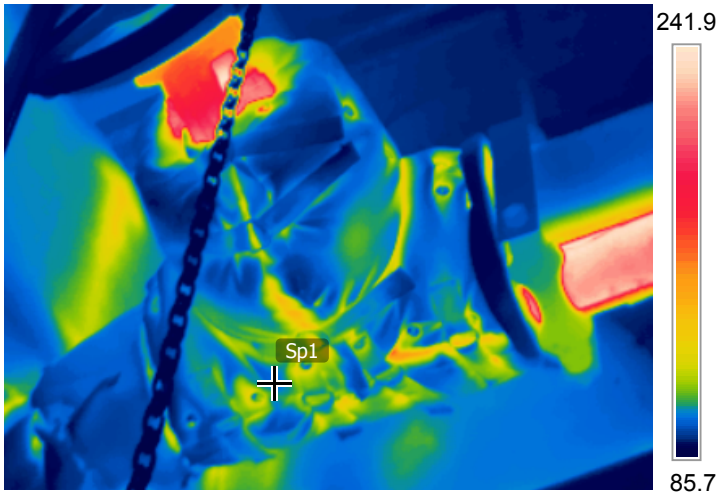

VJIRA11IR_1522.jpg FLIR T300 48801115

Measurements	°F
Sp1	104.3

Parameters	
Emissivity	0.95
Refl. temp.	68 °F